



UNIVERSITY OF PENNSYLVANIA  
FACILITIES SERVICES  
3101 WALNUT STREET  
PHILADELPHIA, PENNA. 19104-6289


MASTER DETAIL  
HVAC DEPARTMENT

TITLE 100% OUTSIDE AIR POINT  
IDENTIFICATION

DATE  
08-01-12


REV DATE

FILE NO.

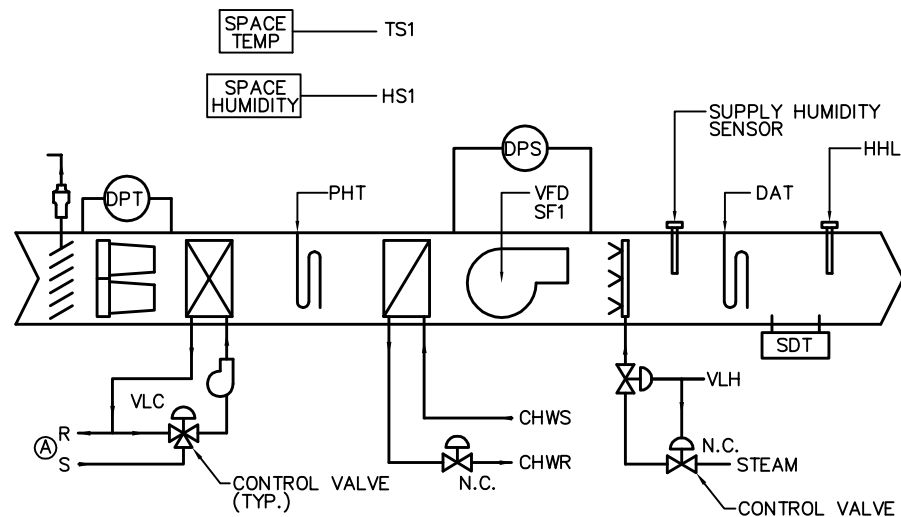

**NOTES:**

- A - FOR SINGLE COIL SEE GLYCOL PREHEAT SYSTEM.
- B - START CURCULATION PUMP WHEN OUTDOOR AIR TEMPERATURE FALLS BELOW 50°F.



100% OUTSIDE AIR POINT IDENTIFICATION

SCALE: NTS