



UNIVERSITY OF PENNSYLVANIA
FACILITIES SERVICES
3101 WALNUT STREET
PHILADELPHIA, PENNA. 19104-6289


MASTER DETAIL
HVAC DEPARTMENT

TITLE DUAL STEAM CONTROL
VALVE ASSEMBLY

DATE
08-01-12


REV DATE

FILE NO.

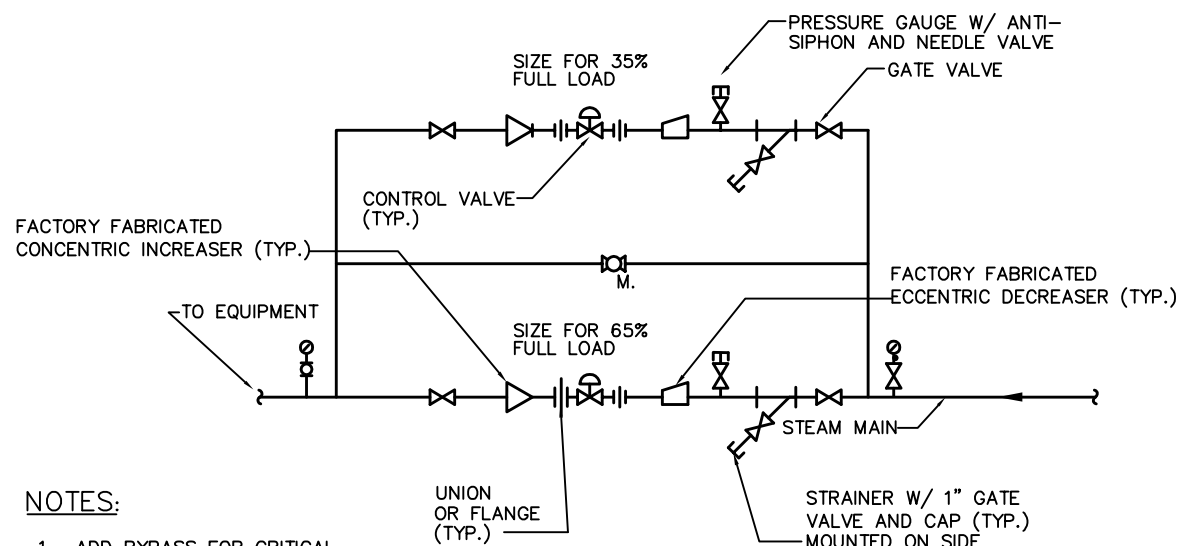

NOTES:

1. ADD BYPASS FOR CRITICAL BUILDING SYSTEMS ONLY.
2. INDICATE CAPACITY FLOW WHERE REQUIRED



DUAL STEAM CONTROL VALVE ASSEMBLY

SCALE: NTS