



UNIVERSITY OF PENNSYLVANIA  
FACILITIES SERVICES  
3101 WALNUT STREET  
PHILADELPHIA, PENNA. 19104-6289


MASTER DETAIL  
HVAC DEPARTMENT

TITLE FLOAT AND THERMOSTAT  
TRAP ASSEMBLY

DATE  
08-01-12


REV DATE

FILE NO.

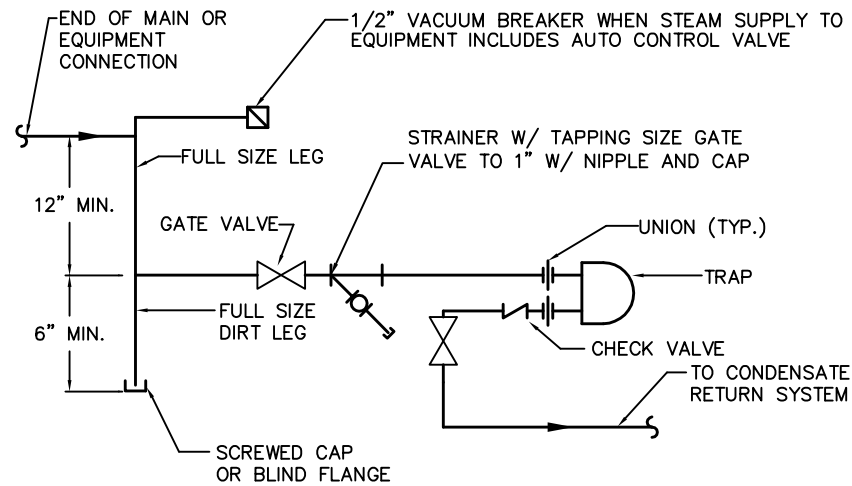

**NOTES:**

1. OMIT CHECK VALVE IF STEAM PRESSURE IS 15 PSIG OR LESS AND CONDENSATE IS NOT LIFTED



**FLOAT AND THERMOSTAT TRAP ASSEMBLY**

SCALE: NTS