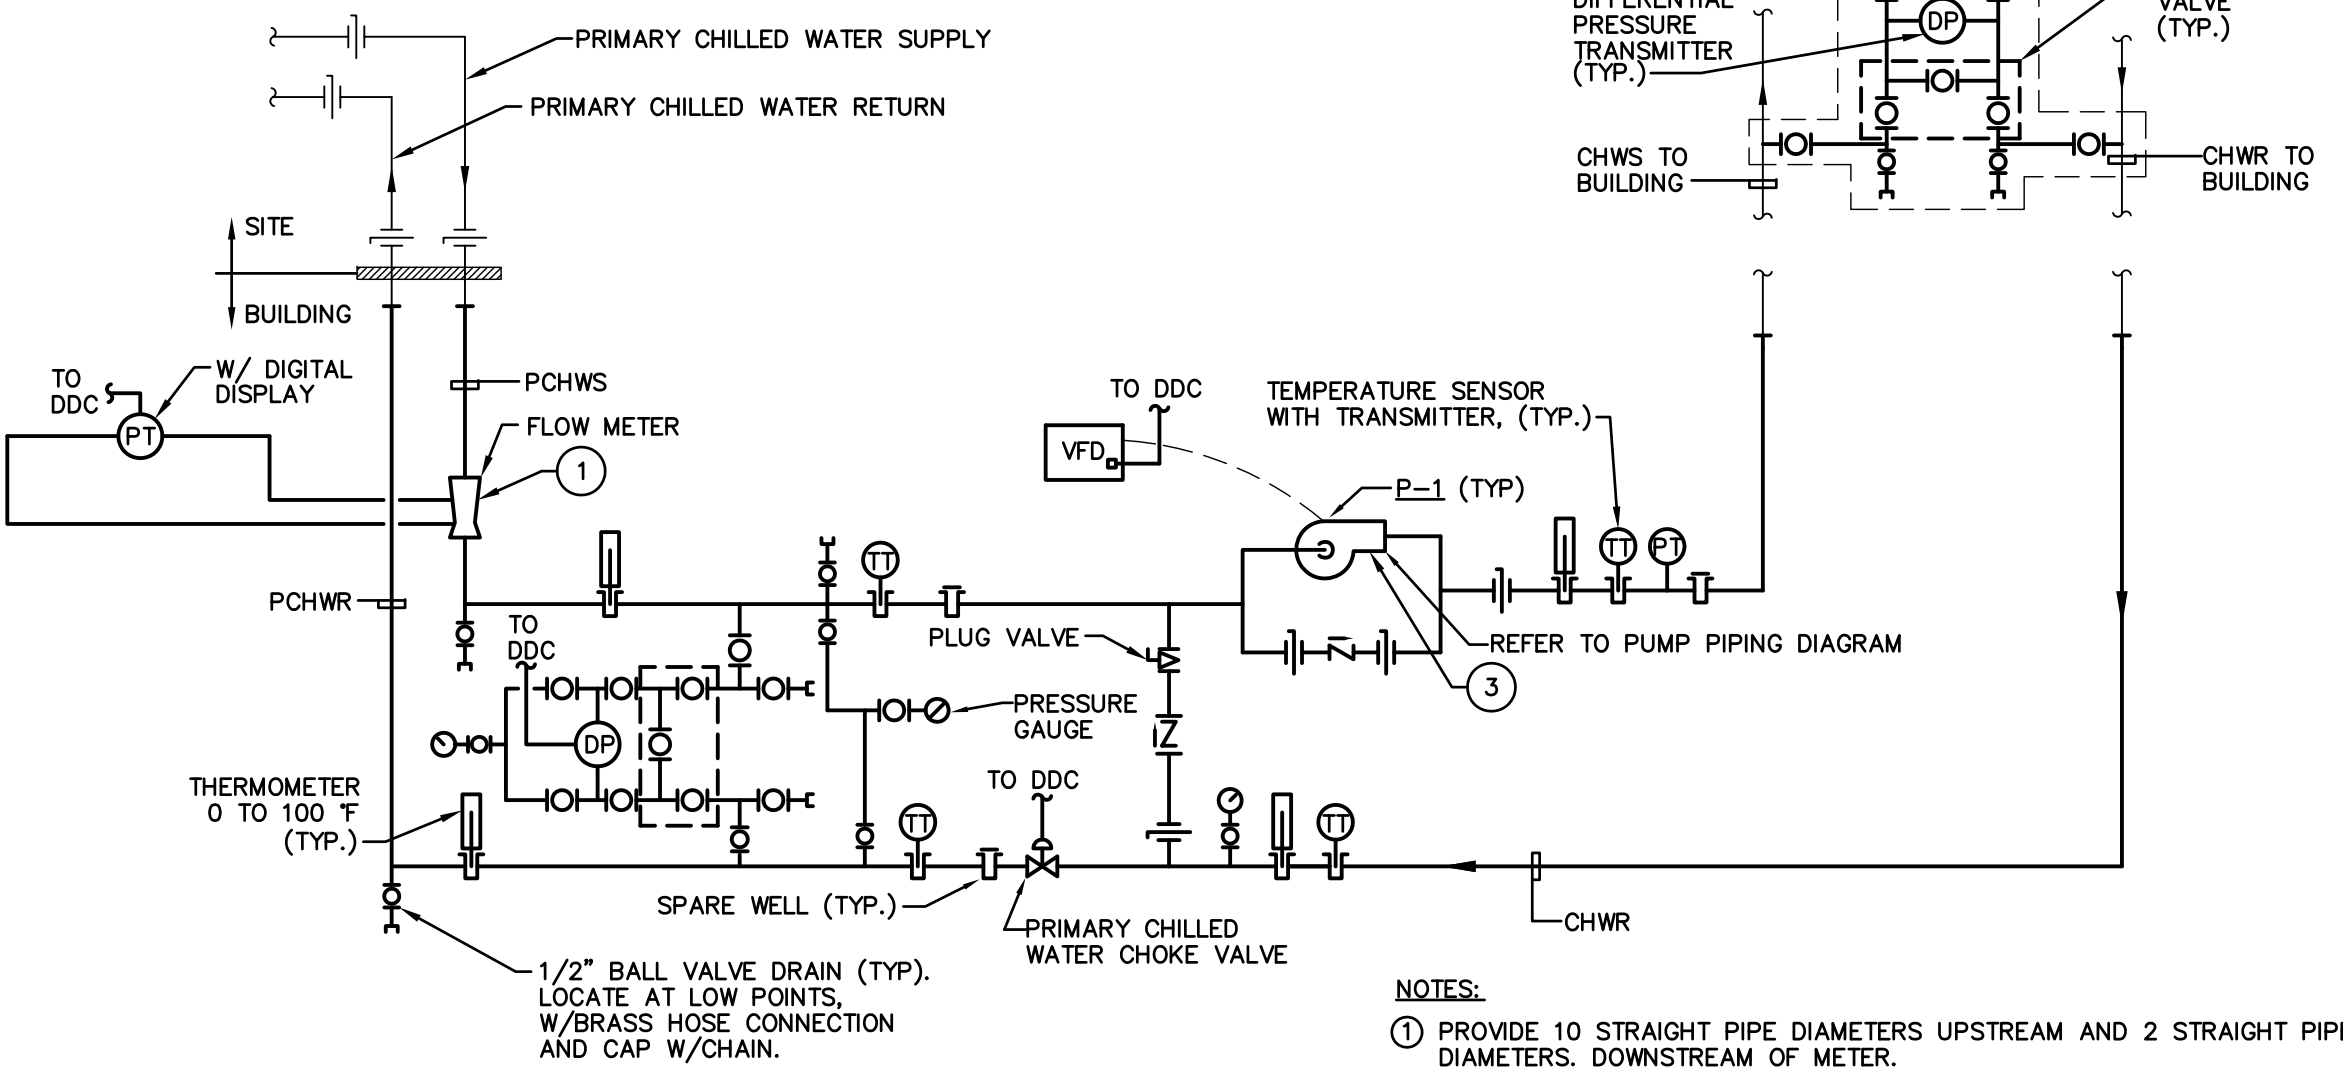

NOTES:

1. PROVIDE 10 STRAIGHT PIPE DIAMETERS UPSTREAM AND 2 STRAIGHT PIPE DIAMETERS. DOWNSTREAM OF METER.
2. REFER TO BUILDING SINGLE LINE DIAGRAMS FOR DPT LOCATION.
3. QUANTITY OF PUMPS VARY PER BUILDING.

PRIMARY/SECONDARY CHILLED WATER INSTRUMENTATION DIAGRAM

SCALE: NONE